

# Wzzard™ Sensing Platform

## Intelligent Edge Nodes

### User Manual



**B+B** SMARTWORX®



**International Headquarters**

B+B SmartWorx  
707 Dayton Road  
Ottawa, IL 61350 USA  
**Phone** (815) 433-5100 -- **General Fax** (815) 433-5105  
[bb-smartsensing.com](http://bb-smartsensing.com)  
[www.bb-smartworx.com](http://www.bb-smartworx.com)  
[support@bb-smartworx.com](mailto:support@bb-smartworx.com)

**European Headquarters**

B+B SmartWorx  
Westlink Commercial Park  
Oranmore, Co. Galway, Ireland  
**Phone** +353 91-792444 -- **Fax** +353 91-792445

## CONTENTS

Warranty.....	5
About the Wzzard Sensing Platform.....	6
Wireless Connectivity Where You Need It.....	6
Contents of Package.....	8
Hardware Installation.....	9
Connecting Your Sensor, Wzzard Industrial Models.....	9
Connecting Your Sensor To Wzzard Industrial Conduit models: Analog and Digital.....	9
Connecting Your Sensor To Wzzard Industrial M12 Models: Analog and Digital.....	12
Terminal Block Connections For Wzzard Industrial Models: Thermocouple.....	13
Connecting Your Sensor to WzzardC™ Commercial Models.....	14
Powering Wzzard Industrial Models.....	15
Powering the Wzzard Industrial Models.....	15
Powering WzzardC™ Commercial Models.....	16
LEDs.....	16
MountING Wzzard Industrial Models.....	17
Mounting Wzzard Industrial Models.....	17
MountING WzzardC™ Commercial Models.....	17
Connecting to Your Intelligent Edge Nodes via Bluetooth LE.....	18
Install the Wzzard App on Your Handheld Device.....	18
CONFIGURING YOUR Wzzard Intelligent Edge Nodes.....	19
Radio.....	19
Device Configuration.....	20
Geolocation.....	20
Analog Inputs.....	21
Internal Temperature.....	22

Thermocouple.....	23
Supply Voltage.....	24
Digital Inputs.....	25
Digital Outputs.....	26
Accelerometer.....	26
Configuration Button.....	28
Specifications for Wzzard Edge Nodes.....	29
Wzzard Industrial Models.....	29
WzzardC™ Commercial Models.....	30
All Wzzard Models.....	31
Radio Specifications.....	32
Mechanical Drawing.....	34
Model Numbers.....	35
Wzzard Industrial Models.....	35
WzzardC™ Commercial Models.....	35
Declaration of Compliance.....	36
Declaration of Conformity CE.....	38

## WARRANTY

B+B SmartWorx warrants to the original end-user purchaser that this product, EXCLUSIVE OF SOFTWARE, shall be free from defects in materials and workmanship under normal and proper use in accordance with B+B SmartWorx' instructions and directions for a period of six (6) years after the original date of purchase. This warranty is subject to the limitations set forth below.

At its option, B+B SmartWorx will repair or replace at no charge the product which proves to be defective within such warranty period. This limited warranty shall not apply if the B+B SmartWorx product has been damaged by unreasonable use, accident, negligence, service or modification by anyone other than an authorized B+B SmartWorx Service Technician or by any other causes unrelated to defective materials or workmanship. Any replaced or repaired products or parts carry a ninety (90) day warranty or the remainder of the initial warranty period, whichever is longer.

To receive in-warranty service, the defective product must be received at B+B SmartWorx no later than the end of the warranty period. The product must be accompanied by proof of purchase, satisfactory to B+B SmartWorx, denoting product serial number and purchase date, a written description of the defect and a Return Merchandise Authorization (RMA) number issued by B+B SmartWorx. No products will be accepted by B+B SmartWorx which do not have an RMA number. For an RMA number, contact B+B SmartWorx at PHONE: (800) 624-1070 (in the U.S and Canada) or (949) 465-3000 or FAX: (949) 465-3020. The end-user shall return the defective product to B+B SmartWorx, freight, customs and handling charges prepaid. End-user agrees to accept all liability for loss of or damages to the returned product during shipment. B+B SmartWorx shall repair or replace the returned product, at its option, and return the repaired or new product to the end-user, freight prepaid, via method to be determined by B+B SmartWorx. B+B SmartWorx shall not be liable for any costs of procurement of substitute goods, loss of profits, or any incidental, consequential, and/or special damages of any kind resulting from a breach of any applicable express or implied warranty, breach of any obligation arising from breach of warranty, or otherwise with respect to the manufacture and sale of any B+B SmartWorx product, whether or not B+B SmartWorx has been advised of the possibility of such loss or damage.

EXCEPT FOR THE EXPRESS WARRANTY SET FORTH ABOVE, B+B SMARTWORX MAKES NO OTHER WARRANTIES, WHETHER EXPRESS OR IMPLIED, WITH RESPECT TO THIS B+B SMARTWORX PRODUCT, INCLUDING WITHOUT LIMITATION ANY SOFTWARE ASSOCIATED OR INCLUDED. B+B SMARTWORX SHALL DISREGARD AND NOT BE BOUND BY ANY REPRESENTATIONS OR WARRANTIES MADE BY ANY OTHER PERSON, INCLUDING EMPLOYEES, DISTRIBUTORS, RESELLERS OR DEALERS OF B+B SMARTWORX, WHICH ARE INCONSISTENT WITH THE WARRANTY SET FORTH ABOVE. ALL IMPLIED WARRANTIES INCLUDING THOSE OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE ARE HEREBY LIMITED TO THE DURATION OF THE EXPRESS WARRANTY STATED ABOVE.

Every reasonable effort has been made to ensure that B+B SmartWorx product manuals and promotional materials accurately describe B+B SmartWorx product specifications and capabilities at the time of publication. However, because of ongoing improvements and updating of B+B SmartWorx products, B+B SmartWorx cannot guarantee the accuracy of printed materials after the date of publication and disclaims liability for changes, errors or omissions.

### WIRELESS CONNECTIVITY WHERE YOU NEED IT

The Wzzard™ intelligent wireless sensor platform makes it quick and easy to connect sensors and communicate their data to your application, on your network or on the Internet, for visualization, analytics or integration into business applications.

The Wzzard platform connects to a vast range of industry-standard sensors. It uses Intelligent Edge Nodes and a wireless SmartMesh IP network to transmit sensor data to the Spectre Network Gateway. The Spectre Network Gateway can connect to the Internet via wired connections or the cellular data network.

Wzzard Intelligent Edge Nodes accommodate external sensors with a wide variety of sensor interface options, including general purpose analog inputs, digital input/output and thermocouple. They can also contain internal sensors like an accelerometer, depending upon the model number.

### Secure, Reliable and Highly Scalable Wireless Networking

The Wzzard platform uses 802.15.4e wireless SmartMesh IP networking technology to deliver reliable, resilient and scalable communication with advanced network management and comprehensive security features. The platform uses full SmartMesh IP networking and time-synchronized channel hopping to provide up to 99.999% connectivity, even in the most demanding RF environments.

The Wzzard wireless sensor platform enables rapid network deployment and expansion. New nodes may be added at any time, and the SmartMesh network dynamically self-configures as new nodes are added or removed. This process is a function of the mesh network itself, and does not need to be controlled by the network gateway.

### Easy Configuration and Installation

Configuration of the Wzzard sensor platform is easy via Android smart phones or tablets with Bluetooth BLE 4.0 or Smart LE. Using the Wzzard app, your handheld devices can configure the Wzzard Intelligent Edge Nodes over their Bluetooth connections. The intelligent edge nodes can be configured with calibration and scaling information, engineering units, friendly names, geolocation and other descriptive information. The MQTT-SN protocol is used to transport sensor data to the network gateway. MQTT-SN is a highly efficient publish/subscribe protocol optimized for sending sensor data over wireless networks.

The platform simplifies physical installation as well. The Wzzard Intelligent Edge Nodes can be attached to any surface using screws or their embedded magnetic bases. The IP66-rated, fiber reinforced polyester PBT housing and the ability to connect to external sensors via conduit fitting cable gland or M12 connector make the units deployable in virtually any industrial or commercial environment.

### Intelligence at the Network Edge

The Wzzard wireless platform places intelligence at the network edge. The Wzzard Intelligent Edge Nodes can be configured to communicate data only when specified threshold or alert levels are exceeded. When reporting, they can associate useful information like geolocation, device name and battery install date. This eliminates unnecessary network traffic, eases the processing burden on upstream resources, and cuts the cost of cellular data plans when the Gateway is using the cellular data

network. Thanks to low-power wireless technology and programmable time synchronization, the Intelligent Edge Nodes can operate for multiple years on just two AA lithium batteries.

### **The Spectre Network Gateway**

The Spectre Network Gateway connects to the SmartMesh IP wireless mesh network and the Wizzard Intelligent End nodes through an integrated 802.15.4e radio. The Spectre Network Gateway receives the incoming data stream from edge nodes in MQTT-SN format and converts the information into MQTT protocol for transport to an MQTT broker on your network or on the Internet.

Uniquely designed with open source LINUX architecture, the Spectre Network Gateway is customizable through installation of software plug-in modules. Users can create their own plug-in modules with common LINUX commands and scripts, or add them from B+B's existing library. Plug-in modules are available for establishing communications with the MQTT broker within a number of IoT application platform providers, including Axeda, Xively, ILS and SeeControl.

The Spectre Network Gateway is built for plug-and-play simplicity with extensive remote management, deployment and customization options. It connects Ethernet equipment and other devices to the Internet or intranet via either cellular 3G or 10/100 wired Ethernet. The standard configuration includes a 10/100 Ethernet port, USB host port, binary input/output (I/O) port and an 802.15.4e radio. It also has an auxiliary port that can be configured for other purposes, like Ethernet or RS-232/485/422.

### **Secure Connections**

To ensure secure communications the Spectre Network Gateway supports the creation of VPN tunnels using IPsec, OpenVPN and L2TP. The web interface provides detailed statistics about gateway activities, signal strength, etc. The gateway supports DHCP, NAT, NAT-T, DynDNS, NTP, VRRP, control by SMS, and many other routing functions. The Spectre Network Gateway also provides diagnostic functions which include automatically monitoring the PPP connection, automatic restart in case of connection losses, and a hardware watchdog that monitors the Spectre Network Gateway status.

## CONTENTS OF PACKAGE

The Wzzard™ Industrial models package includes:

- Wzzard™ Industrial Intelligent Edge Node
- Sensor wire harness cable - conduit connection models only
- 2 3.6V AA Thionyl Chloride Lithium Batteries
- External Antenna (some models)
- Quick Start Guide
- Anti-Skid Disk

The WzzardC™ Commercial models package includes:

- WzzardC™ Commercial Intelligent Edge Node
- 2 3.6V AA Thionyl Chloride Lithium Batteries
- Quick Start Guide
- Dual lock adhesive Velcro strips



## HARDWARE INSTALLATION

### CONNECTING YOUR SENSOR, WZZARD INDUSTRIAL MODELS

#### CONNECTING YOUR SENSOR TO WZZARD INDUSTRIAL CONDUIT MODELS: ANALOG AND DIGITAL

It is best practice that wiring is done prior to installing batteries or powering up the device.

Remove the four screws that hold the top of the Wzzard node in place. Thread the wire harness through the conduit.



Plug the included wire harness into the receptacle on the circuit board inside the node.



Connect your sensor to the wires running from the node's conduit. Consult the charts below for wire colors and connections.

WIRING FOR WZZARD INTELLIGENT EDGE NODES WITH SMARTMESH IP – CONDUIT MODELS

	1 Brown	2 Red	3 Pink	4 Yellow	5 Green	6 Blue	7 White	8 Gray
WSD2CTJ	3.3V					DO2	GND	GND
WSD1CTJ	3.3V					DO2	GND	GND
WSD2CTK	3.3V					DO2	GND	GND
WSD1CTK	3.3V					DO2	GND	GND
WSD2XV0	3.3V							GND
WSD1XV0	3.3V							GND
WSD2CA2	3.3V	AIN1	GND	AIN2	GND	DO2	3.3REF	GND
WSD1CA2	3.3V	AIN1	GND	AIN2	GND	DO2	3.3REF	GND
WSD2CD2	3.3V	DIN1	DIN2	DO1	DO2	GND	GND	GND
WSD1CD2	3.3V	DIN1	DIN2	DO1	DO2	GND	GND	GND
WSD2CA3	3.3V	AIN1	GND	AIN2	GND	AIN3	GND	GND
WSD1CA3	3.3V	AIN1	GND	AIN2	GND	AIN3	GND	GND

3.3V = 3.3V power input  
 3.3REF= 3.3V output reference  
 AIN1= Analog Input #1  
 AIN2= Analog Input #2  
 AIN3= Analog Input #3  
 DIN1= Digital Input #1  
 DIN2= Digital Input #2  
 D01= Digital Output #1  
 D02= Digital Output #2  
 GND= Ground Input

WIRING FOR WZZARD INTELLIGENT EDGE NODES WITH SMARTMESH IP – M12 MODELS

	1 White	2 Brown	3 Green	4 Yellow	5 Gray	6 Pink	7 Blue	8 Red
WSD2MA2	3.3V	AIN1	GND	AIN2	GND	DO2	3.3REF	GND
WSD1MA2	3.3V	AIN1	GND	AIN2	GND	DO2	3.3REF	GND
WSD2MD2	3.3V	DIN1	DIN2	DO1	DO2	GND	GND	GND
WSD1MD2	3.3V	DIN1	DIN2	DO1	DO2	GND	GND	GND
WSD2MA3	3.3V	AIN1	GND	AIN2	GND	AIN3	GND	GND
WSD1MA3	3.3V	AIN1	GND	AIN2	GND	AIN3	GND	GND
3.3V = 3.3V power input 3.3REF= 3.3V output reference AIN1= Analog Input #1 AIN2= Analog Input #2 AIN3= Analog Input #3 DIN1= Digital Input #1 DIN2= Digital Input #2 DO1= Digital Output #1 DO2= Digital Output #2 GND= Ground Input								


## CONNECTING YOUR SENSOR TO WZZARD INDUSTRIAL M12 MODELS: ANALOG AND DIGITAL

It is best practice that wiring is done prior to installing batteries or powering up the device.

Remove the four screws that hold the top of the Wzzard node in place.

Confirm that the wire harness from the M12 port is connected to the circuit board inside the Wzzard Edge Node.

Wire your M12 cable according to the diagram below.

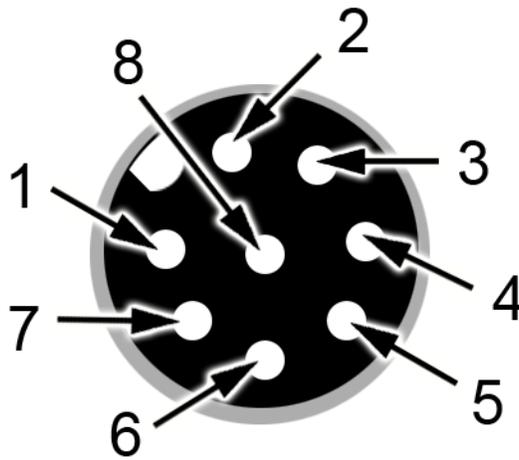

**Wzzard M12 Pinout**

---

## TERMINAL BLOCK CONNECTIONS FOR WZZARD INDUSTRIAL MODELS: THERMOCOUPLE

It is best practice that wiring is done prior to installing batteries or powering up the device.

Remove the 4 screws that hold the top of the Wzzard node in place. Thread the thermocouple wires through the conduit and attach them to the terminal block. It is best practice that wiring is done prior to installing batteries or powering up the device.


1 = Thermocouple input #1 positive (+)

2 = Thermocouple input #1 negative (-)

3 = Thermocouple input #2 positive (+)


4 = Thermocouple input #2 negative (-)

Close the Wzzard node and replace the 4 screws.

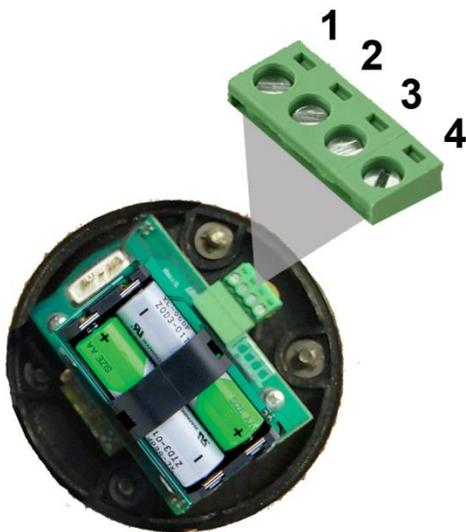

## CONNECTING YOUR SENSOR TO WZZARDC™ COMMERCIAL MODELS

Connect your sensor wires to the terminal block. Consult the chart below for terminal block pin assignments.

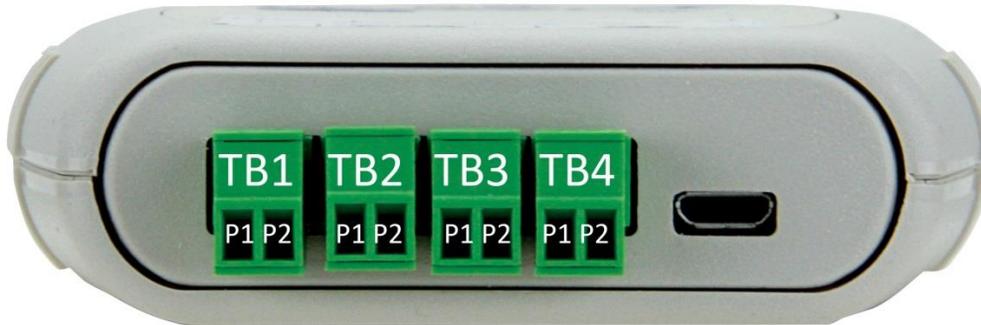

WIRING FOR WZZARDC™ COMMERCIAL EDGE NODES WITH SMARTMESH IP								
	TB1 Pin 1	TB1 Pin 2	TB2 Pin 1	TB2 Pin 2	TB3 Pin 1	TB3 Pin 2	TB4 Pin 1	TB4 Pin 2
WCD1TA3	GND	AIN1	GND	AIN1	GND	AIN1	GND	3.3V
WCD1TD2	GND	DIN1	GND	DIN2	GND	DO1	GND	DO2
WCD1TTJ	T1+	T1-	T2+	T2-	GND	DO2	N/C	N/C

3.3V = 3.3V power output  
 AIN1 = Analog Input #1  
 AIN2 = Analog Input #2  
 AIN3 = Analog Input #3  
 DIN1 = Digital Input #1  
 DIN2 = Digital Input #2  
 DO1 = Digital Output #1  
 DO2 = Digital Output #2  
 T1+ = J Type Thermocouple Input #1 positive (+)  
 T1- = J Type Thermocouple Input #1 negative (-)  
 T2+ = J Type Thermocouple Input #2 positive (+)  
 T2- = J Type Thermocouple Input #2 negative (-)  
 N/C = Not Connected  
 GND = Ground Input

## POWERING WZZARD INDUSTRIAL MODELS

### POWERING THE WZZARD INDUSTRIAL MODELS

Remove the 4 black screws that hold the top of the node in place.  
Install two 3.6 V AA Thionyl Chloride lithium batteries.




In most installations you will only need to place the batteries in the battery holder. But in high vibration environments you should also use the optional battery retaining clip. Do not use excessive force while placing or removing the clip, as you can break it.

The best way to remove the clip is to insert a small flathead screwdriver between the batteries and the clip, parallel to the batteries, and give the screwdriver a gentle twist. This will remove the clip without damage.



As with all batteries, these are a fire, explosion, and severe burn hazard. Do not burn or expose them to high temperatures. Do not recharge, crush, disassemble, or expose the contents to water. Properly dispose of used batteries according to local regulations by taking it to a hazardous waste collection site, an e-waste disposal center, or other facility qualified to accept lithium batteries.

## POWERING WZZARDC™ COMMERCIAL MODELS

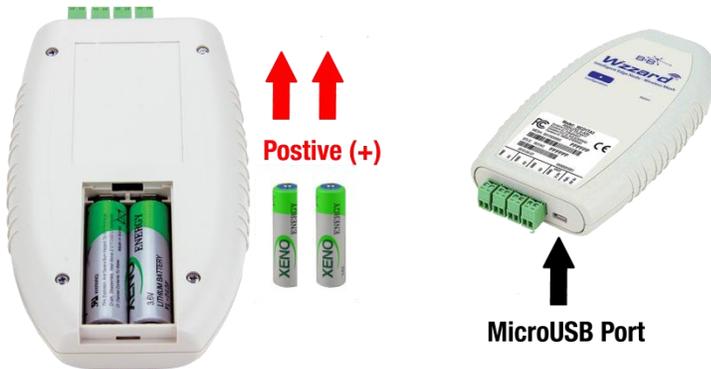

Remove back cover. Insert both batteries with the positive (+) towards the terminal blocks.

(The unit can also be powered through the microUSB connector)

## LEDS

After you have installed the batteries the LED will begin to blink. This indicates that the Node is attempting to establish a network connection. The LED will cease blinking when a connection is made.

Status LED		
Data	Solid On	Module startup initialization, approx. 10 sec.
	Slow Blink	Attempting to establish connection with SmartMesh IP network – 1 sec on/1 sec off
	Fast Blink	Firmware Update in progress – 10 blinks per sec
	OFF	Unit is connected to wireless network

## MOUNTING WZZARD INDUSTRIAL MODELS

### MOUNTING WZZARD INDUSTRIAL MODELS

Wzzard nodes may be mounted either with screws or with their internal magnets. Attach Anti-Skid disk to bottom of unit to prevent slipping on metal surfaces.

#### Flange Mounting

Wzzard nodes may be mounted via their mounting ears. (M5, #10)



#### Magnetic Mounting

Wzzard nodes contain a powerful, internal mounting magnet. (Pull force 4.7 lbs, 2.13 kg)  
The magnet is in the base of the Wzzard node.



### MOUNTING WZZARDC™ COMMERCIAL MODELS

#### Velcro Mounting

The Wzzard node may be mounted with the supplied dual lock adhesive Velcro strips.



#### Holster Mounting

B+B offers a holster mount as an accessory. It may be purchased as part number WCHOLST..



## CONNECTING TO YOUR INTELLIGENT EDGE NODES VIA BLUETOOTH LE

### INSTALL THE WZZARD APP ON YOUR HANDHELD DEVICE

You may install the Wzzard app on your Android handheld device. Your handheld device **MUST** be compatible with Bluetooth LE 4.0.

The Android APP version is available on Google Playstore Search store for **“Wzzard Sensor Application.”**

1. Open the Wzzard App
2. Press the “Configuration’ button on the device for at least 1 second to wake up Bluetooth radio (the LED will come on to signify this)
3. Press the device you would like to view. (This screen lets the user view Bluetooth advertisements from the Nodes.)
4. Press the Configure Device button.
5. Pair with the device. Default username/password is admin/admin.
6. Press the “Radio Setup” button to set the Network ID and Network Join Key. (These must be the same values that you enter in the corresponding network gateway.)

Press the ‘Save’ button to save the new settings.

7. Refer to the Wzzard Bluetooth App User manual for further node programming instructions.

Documents can be found at <http://www.bb-smartsensing.com/technical-documentation>

The screenshot shows the Wzzard app interface on an Android device. At the top, the status bar shows 39% battery and 11:20 AM. The app header includes a back arrow, the logo 'B:B SMARTWORX', and a settings gear icon. Below the header, a blue button displays 'Device: WSD1CTJ'. Underneath, the 'Radio Setup (Basic)' section contains a white button labeled 'See Advanced Settings'. The 'Network' section, highlighted with a blue header, includes two input fields: 'Network ID' with the value '1981' and an empty 'Network Join Key' field. The 'Bluetooth LE Setup' section, also with a blue header, features a toggle for 'Advertise During Sleep' set to 'OFF', a time picker for 'Advertise Rate' set to '0:00:10', a text field for 'Username' containing 'admin', and a password field with masked characters. A prominent red 'Save' button is located at the bottom of the configuration area. The bottom of the screen shows the Android navigation bar with four icons.

## CONFIGURING YOUR WZZARD INTELLIGENT EDGE NODES

### RADIO

Configuration Screen	Parameter	Parameter Range	Default Value	Description
<b>Radio</b>				
	<b>Network ID</b>	1-65534	1981	Unique identifier for the sensor network. This ID must match the ID programmed into the network gateway.
	<b>Network Join Key</b>	32 hexadecimal characters	The keyword 'default' will return this setting back to the factory default value.	128-bit encryption key for the network which is entered as a 32 hex character string (i.e. 19ABD...). This key must match the key programmed into the network gateway.
	<b>Advertise During Sleep</b>	On/Off	Off	Enables sensor broadcast messages over the Bluetooth LE interface while the node is asleep.
	<b>Advertise Rate</b>	10 seconds to 24 hours	10	Time interval in seconds between each set of broadcast messages during sleep. Longer intervals will preserve battery life.
	<b>Username</b>	16 characters	admin	Login name for configuring the node.
	<b>Password</b>	16 characters	admin	Password for configuring the node.
<b>Radio -&gt; advanced</b>	<b>Join Duty Cycle</b>	0 – 100	25	The percent of time that the node will be awake searching for a network to join. A higher value allows the node to connect to the gateway faster but uses more battery current.

## DEVICE CONFIGURATION

Configuration Screen	Parameter	Parameter Range	Default Value	Description
Device Configuration				
	<b>Description</b>	0-40 characters		User-defined text field to describe the node (max 40 chars).
	<b>Exception-based Measurement Interval</b>	0, 10 seconds to 24 hours	0	Determines how frequently the node will wake up to check for an alarm level. A value of '0' disables this feature. Non-zero values enable the exception/alert feature for the sensors.
	<b>Publish Interval</b>	10 seconds to 24 hours	1 minute	Determines the interval between publishes to the network gateway.

## GEOLOCATION

Configuration Screen	Parameter	Parameter Range	Default Value	Description
Geolocation				
	<b>Latitude</b>	-90.0 to 90.0 degrees		Geographical location of the sensor.
	<b>Longitude</b>	-180.0 to 180.0 degrees		Geographical location of the sensor.
	<b>Elevation</b>	-999999.9 to 999999.9		Elevation of the sensor.

## ANALOG INPUTS

Configuration Screen	Parameter	Parameter Range	Default Value	Description
<b>Analog Inputs</b>				
	<b>Sensor Enable</b>	On/Off	On	Enables/disables the sensor for use on the node.
	<b>Analog Input Type</b>	0-20mA, 4-20mA, 0-5V, 1-5V	0-5V	The type of sensor connected to the input.
	<b>Sensor Label</b>	32 characters	ainx	User-defined text field to describe the sensor input (max 32 chars).
	<b>Measurement Unit</b>	8 characters	V	Engineering unit of measure (max 8 chars).
	<b>Sensor Span Point</b>	-999999.9 to 999999.9	5.0	The value that is reported when the input is at the maximum value.
	<b>Sensor Zero Point</b>	-999999.9 to 999999.9	0.0	The value that is reported when the input is at the minimum value.
	<b>Enable Exception</b>	On/Off	Off	Show/hide the exception/alert options for the sensor. Setting the alert values will provide a quick publish (based on the measurement interval) if an alert level is reached.
	<b>Alert High</b>	-999999.9 to 999999.9	Lowest of Sensor Span Point, Sensor Zero Point- highest of Sensor Span Point, Sensor Zero Point	The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>Alert Low</b>	-999999.9 to 999999.9	Lowest of Sensor Span Point, Sensor Zero Point- highest of Sensor Span Point, Sensor Zero Point	The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>BLE Advertisement Enable</b>	On/Off	On	When enabled, the node will broadcast the sensor value over the Bluetooth interface.

## INTERNAL TEMPERATURE

Configuration Screen	Parameter	Parameter Range	Default Value	Description
<b>Internal Temperature</b>				
	<b>Sensor Enable</b>	On/Off	On	Enables/disables the sensor for use on the node.
	<b>Sensor Label</b>	32 characters	tempint	User-defined text field to describe the sensor input (max 32 chars).
	<b>Measurement Unit</b>	C/F	C	Engineering unit of measure (max 8 chars).
	<b>Enable Exception</b>	On/Off	Off	Show/hide the exception/alert options for the sensor. Setting the alert values will provide a quick publish (based on the measurement interval) if an alert level is reached.
	<b>Alert High</b>	-999999.9 to 999999.9		The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>Alert Low</b>	-999999.9 to 999999.9		The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>BLE Advertisement Enable</b>	On/Off	On	When enabled, the node will broadcast the sensor value over the Bluetooth interface.

## THERMOCOUPLE

Configuration Screen	Parameter	Parameter Range	Default Value	Description
<b>Thermocouple</b>				
	<b>Sensor Enable</b>	On/Off	On	Enables/disables the sensor for use on the node.
	<b>Sensor Label</b>	32 characters	tempx	User-defined text field to describe the sensor input (max 32 chars).
	<b>Measurement Unit</b>	C/F	C	Engineering unit of measure (max 8 chars).
	<b>Enable Exception</b>	On/Off	Off	Show/hide the exception/alert options for the sensor. Setting the alert values will provide a quick publish (based on the measurement interval) if an alert level is reached.
	<b>Alert High</b>	-999999.9 to 999999.9		The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>Alert Low</b>	-999999.9 to 999999.9		The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>BLE Advertisement Enable</b>	On/Off	On	When enabled, the node will broadcast the sensor value over the Bluetooth interface.

## SUPPLY VOLTAGE

Configuration Screen	Parameter	Parameter Range	Default Value	Description
Supply Voltage				
	<b>Sensor Enable</b>	On/Off	On	Enables/disables the sensor for use on the node.
	<b>Sensor Label</b>	32 characters	vbatt	User-defined text field to describe the sensor input (max 32 chars).
	<b>Measurement Unit</b>	V	V	Engineering unit of measure (max 8 chars).
	<b>Enable Exception</b>	On/Off	Off	Show/hide the exception/alert options for the sensor. Setting the alert values will provide a quick publish (based on the measurement interval) if an alert level is reached.
	<b>Alert High</b>	3.0 - 4.0		The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>Alert Low</b>	2.4 - 3.0	Recommended value of 2.6 should be used.	The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>BLE Advertisement Enable</b>	On/Off	On	When enabled, the node will broadcast the sensor value over the Bluetooth interface.

## DIGITAL INPUTS

Configuration Screen	Parameter	Parameter Range	Default Value	Description
<b>Digital Inputs</b>				
	<b>Sensor Enable</b>	On/Off	On	Enables/disables the sensor for use on the node.
	<b>Sensor Label</b>	32 characters	dinx	User-defined text field to describe the sensor input (max 32 chars).
	<b>Measurement Unit</b>	8 characters		Engineering unit of measure (max 8 chars).
	<b>Digital Input Type</b>	bool, count, rate	bool	The type of sensor connected to the input - either a Boolean input, a counter/totalizer, or a rate meter.
	<b>Enable Exception</b>	On/Off	Off	Show/hide the exception/alert options for the sensor. Setting the alert values will provide a quick publish (based on the measurement interval) if an alert level is reached.
	<b>Alert High</b>	Boolean: 1 Rate: 0.0 to 999999.9		The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>Alert Low</b>	Boolean: 0 Rate: 0.0 to 999999.9		The node will send a publish to the network gateway when the input reaches this value. A blank field (or no value) disables this alert.
	<b>Invert Input</b>	True/False	False	Changes the input from an active high input to an active low input.
	<b>BLE Advertisement Enable</b>	On/Off	On	When enabled, the node will broadcast the sensor value over the Bluetooth interface.
	<b>True Message</b>	8 characters		Message that is displayed when the Boolean input is true.
	<b>False Message</b>	8 characters		Message that is displayed when the Boolean input is false.
	<b>Period</b>	seconds	1.0	Measurement period for determining the rate for the rate meter. (Read only at this time)
	<b>Multiplier</b>	0.000001 to 999999.9	1.0	The scale factor for the counter and rate meter.


## DIGITAL OUTPUTS

Configuration Screen	Parameter	Parameter Range	Default Value	Description
<b>Digital Outputs</b>				
	<b>Sensor Enable</b>	On/Off	On	Enables/disables the sensor for use on the node.
	<b>Sensor Label</b>	32 characters	dox	User-defined text field to describe the sensor input (max 32 chars).
	<b>Invert Output</b>	True/False	False	Inverts the level of the output.
	<b>BLE Advertisement Enable</b>	On/Off	On	When enabled, the node will broadcast the sensor value over the Bluetooth interface.

## ACCELEROMETER

Configuration Screen	Parameter	Parameter Range	Default Value	Description
<b>Accelerometer</b>				
	<b>Sensor Enable</b>	On/Off	On	Enables/disables the sensor for use on the node.
	<b>Sensor Label</b>	32 characters	accel1	User-defined text field to describe the sensor input (max 32 chars).
	<b>Measurement Unit</b>	8 characters	[g]	Engineering unit of measure.
	<b>BLE Advertisement Enable</b>	On/Off	On	When enabled, the node will broadcast the sensor value over the Bluetooth interface.
	<b>Accelerometer Granularity</b>	2G, 4G, 8G	4G	Measurement range of the accelerometer. A lower value will increase the sensitivity of the accelerometer.
	<b>Accelerometer Interval</b>	12.5, 25, 50, 100, 200, 400Hz	100Hz	Frequency Response of the accelerometer. A higher value will allow the accelerometer to capture faster events.

Output increases with acceleration in the direction of the arrows



**X**

Left / Right



**Y**

Forward / Back



**Z**

Up / Down

## CONFIGURATION BUTTON

When you press and hold the “Configuration” button on the Node for more than 5 seconds:

- It will cause the LED to flash quickly a couple of times
- It will restore the BLE login and password to factory settings.
- It will restart the device.

This action will not reset the device back to all factory settings.

When you press and hold the “Configuration” button on the node for at least 1 second but less than 5 seconds:

- LED will turn on (hold button until LED is seen)
- It will Wake-up the device and turn on the BLE radio
- This will enable the Wzzard App to communicate to the node



## SPECIFICATIONS FOR WZZARD EDGE NODES

### WZZARD INDUSTRIAL MODELS



<b>Power Supply</b>	
Sources	2 Lithium Primary Cells in parallel. Optional External Supply
External Input Voltage	3.3 VDC +/- 5%
Connectors	M12
	1/2" Conduit, sensor interface cable included; 8 wire, 26 gage, 6 ft.
Battery Life	Multiple years based on 1 min sensor sampling and reporting
<b>Environmental</b> -- Intended for indoor and outdoor use.	
Operating Temperature	-40 to 80°C (-40 to 176°F)
Storage Temperature	-40 to 85°C (-40 to 185°F)
Operating Humidity	0 to 95% non-condensing
<b>LED indicators</b>	
Data	Color = Green Blink = Attempting to establish network connection Off = Device connected to network
<b>Enclosure Rating</b>	
Rating	IP66-rated, fiber reinforced polyester PBT
Mounting	Mountable by use of built-in magnets or mounting ears
<b>Certifications</b>	
<b>FCC/IC</b>	
FCC Part 15 Class A	
FCC - Part 15.247	
Industry Canada - RSS210	
<b>CE</b>	
EN55022	CISPR (EN55022) Class A
EN 61000-6-2:2005	Generic immunity standard for (heavy) industrial environments
EN 61000-6-4:2006 +A1:2011	Emission standard for (heavy) industrial environments
EN61000-4-2	ESD +/- 8kV air, +/- 4kV contact
EN61000-4-3	RFI
EN61000-4-4	EFT
EN61000-4-5	Surge
EN61000-4-6	CI
EN60255-21-1	Vibration, 2g, 10-500Hz 0.3mm displacement
EN60255-21-2	Shock, 50g, 11ms half sine wave, 18 shocks
<b>Safety</b>	
UL/CSA Class 1, Division 2 Groups A, B, C, D	

<b>Environmental</b>	
IEC 60068-2-6:2007	Vibration, 2g, 10-500 Hz, 1.5mm displacement
IEC 60068-2-27:2008	Shock, 50g, 11ms half sine wave, 18 shocks
<b>Regulatory Approvals</b>	
RoHS and WEEE Compliant	

## WZZARDC™ COMMERCIAL MODELS



<b>Power Supply</b>	
Sources	2 Lithium Primary Cells in parallel or MicroUSB input
External Input Voltage	3.3 VDC +/- 5%
Connectors	3.5 mm terminal blocks Analog Input (0 - 5 VDC, 0 – 20 mA, 4 – 20 mA) Digital Input (0-48 VDC) Digital Input Frequency 1-1K Hz, Accuracy +/- 1Hz
Battery Life	Multiple years based on 1 min sensor sampling and reporting
<b>Environmental -- Intended for indoor use.</b>	
Operating Temperature	0 to 65°C (32 to 149°F)
Storage Temperature	-0 to 70°C (32 to 158°F)
Operating Humidity	0 to 95% non-condensing
<b>LED indicators</b>	
Data	Color = Green Blink = Attempting to establish network connection Off = Device connected to network
<b>Enclosure Mounting</b>	
Mounting	Mountable by use of adhesive Velcro strips or holster mount
<b>Certifications</b>	
<b>FCC/IC</b>	
FCC Part 15 Class A	
FCC - Part 15.247	
Industry Canada - RSS210	
<b>CE</b>	
EN55022	CISPR (EN55022) Class A
EN 61000-6-1:2007	Generic immunity standard for residential, commercial and light-industrial environments
EN 61000-6-3:2006 +A1:2011	Emission standard for residential, commercial and light-industrial environments
EN61000-4-2	ESD +/- 8kV air, +/- 4kV contact
EN61000-4-3	RFI

EN61000-4-4	EFT
EN61000-4-6	CI
<b>Regulatory Approvals</b>	
RoHS and WEEE Compliant	

## ALL WZZARD MODELS

<b>Digital Inputs</b>	
Voltage range	0 – 48 VDC
V <sub>IL</sub>	0.97V Maximum
V <sub>IH</sub>	1.8V Minimum
Pull up current	32uA
Type	Sourcing (PNP)/Sinking (NPN) Software selectable input
Isolation	None
<b>Rate/Frequency Inputs</b>	
Frequency	Does a 1 second measurement at each measurement/publish interval
	1-1K Hz (Accuracy + or – 1 Hz)
	Uses the falling edge or rising edge based on the Invert Enabled setting
<b>Counter Input</b>	
Channels	Actively counts either the falling edge (Invert enabled) or rising edge (Invert disabled)
	Can use a multiplier to convert to a unit type or count
	2 selectable/shared with Digital inputs
	Rolls over at 999999.9
<b>Analog Inputs</b>	
Input ranges	0-5 VDC, 0–20 mA
Accuracy @ 25°C	Voltage: 0.10% full scale reading, 0.20% max. Current: 0.11% full scale reading, 0.24% max.
Resolution	12 bit
Input load resistance	100 Mega ohm (0-5VDC), 250 ohm (0-20ma)
<b>Thermocouple Input</b>	
Types Supported	J and K (Industrial Model Only)
Ranges Supported	Type J -210 to +1,200 °C Type K -270 to +1,372 °C
Resolution	0.25°C
Accuracy	Typical +/-2°C +/-6°C over the temperature range of -40 to 80°C (Industrial) 0-65°C (Commercial)
<b>Digital Outputs</b>	
Voltage range	0-30 VDC

Output Type	Open Drain
Output Current	Not to be less than 100ma
Protection	Current Limit Protection
Isolation	None

## RADIO SPECIFICATIONS

SmartMesh IP 802.15.4e RADIO SPECIFICATIONS					
Parameter	Conditions	Min	Typ	Max	Units
Frequency Band		2,400		2,4835	GHz
Number of Channels			15		
Channel Separation			5		MHz
Channel Clear Frequency			$2405 + 5*(k-11)$		MHz
Modulation	IEEE 802.15.4 Direct Sequence Spread Spectrum (DSSS)				
Raw Data Rate			250		kbps
Range	25 °C, 50% RH, +2dBi Omni-Directional Antenna, Antenna 2 m above ground	m			
	Indoor		100		m
	Outdoor		300		m
	Free Space		1200		m
Receiver Sensitivity	Packet Data Error Rate (PER) = 1%			-93	dBm
Receiver Sensitivity	PER = 50%			-95	dBm
Output Power	Delivered to a 50 Ω load			8	dBm

BLUETOOTH LE RADIO SPECIFICATIONS						
No	Characteristics	Conditions	Min	Typ	Max	Units
1	Operation Frequency Range		2402		2480	MHz

2	Channel Spacing			2		MHz
3	Output Power			4		dBm
4	Sensitivity, High Gain Mode	High Gain Mode		-93.0	-70	dBm
		Standard Mode		-92.5	-70	dBm

<b>THIONYL CHLORIDE LITHIUM BATTERIES (2 SUPPLIED WITH PRODUCT)</b>	
Characteristics	Conditions
Temperature Range	-40 to 85°C
Nominal Capacity	2.4 Ah
Nominal Voltage	3.6 V
Diameter	14.5 mm
Height	50.5 mm
*Potential hazard: Do not recharge, crush, disassemble or heat above 212°F (100°C)	

## MECHANICAL DRAWING

### Wzzard Industrial Models

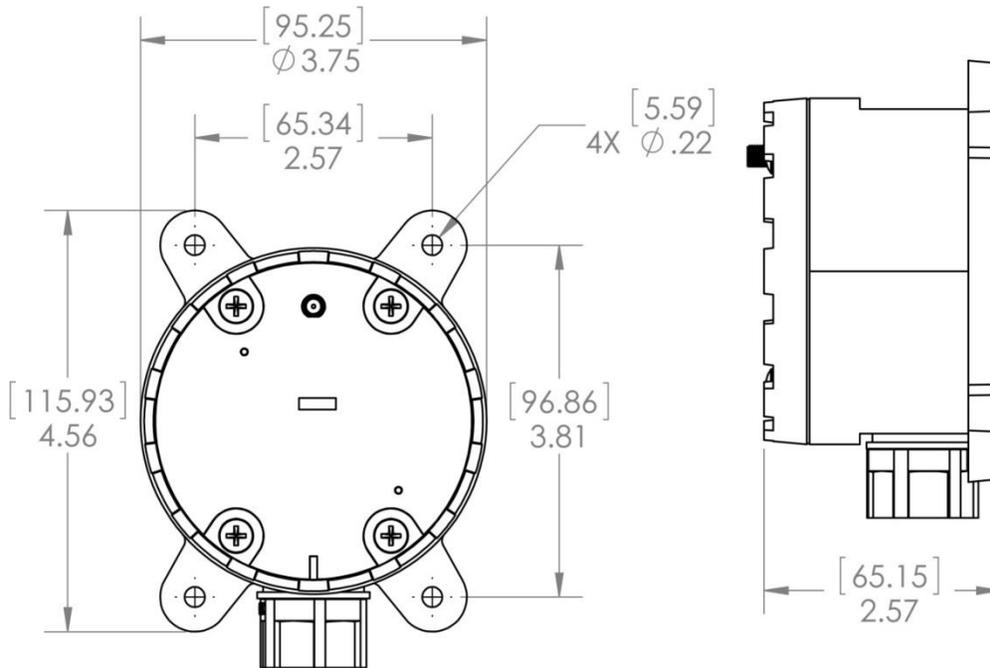


Figure 1: Mechanical drawing for Industrial models

### WzzardC™ Commercial Models

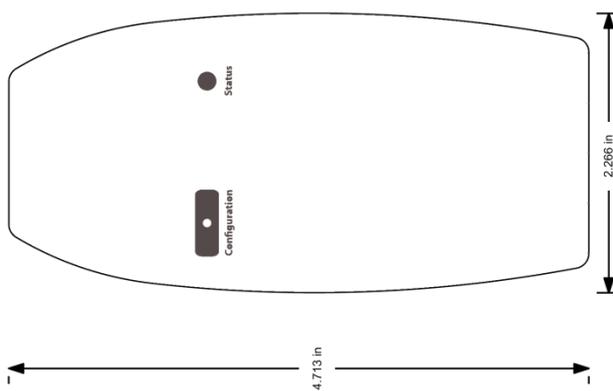


Figure 2. Mechanical drawing for WzzardC™ Commercial models

## MODEL NUMBERS

### WZZARD INDUSTRIAL MODELS

<b>Wzzard Intelligent Edge Nodes with SmartMesh IP and Bluetooth LE</b>	
<b>Model Number</b>	<b>Thermocouple</b>
WSD2CTJ	Wireless Mesh 802.15.4e; 2 Thermocouple J-type inputs, 1 Digital Output; External Antenna, Conduit Connector
WSD1CTJ	Wireless Mesh 802.15.4e; 2 Thermocouple J-type inputs, 1 Digital Output; Internal Antenna, Conduit Connector
WSD2CTK	Wireless Mesh 802.15.4e; 2 Thermocouple K-type inputs, 1 Digital Output; External Antenna, Conduit Connector
WSD1CTK	Wireless Mesh 802.15.4e; 2 Thermocouple K-type inputs, 1 Digital Output; Internal Antenna, Conduit Connector
<b>Model Number</b>	<b>Accelerometer</b>
WSD2XV0	Wireless Mesh 802.15.4e Integrated Accelerometer; External Antenna
WSD1XV0	Wireless Mesh 802.15.4e Integrated Accelerometer; Internal Antenna
<b>Model Number</b>	<b>Analog Inputs</b>
WSD2MA2	Wireless Mesh 802.15.4e; 2-Analog Inputs, 1 Digital Output; External Antenna, M12 Connector
WSD1MA2	Wireless Mesh 802.15.4e; 2-Analog Inputs, 1 Digital Output; Internal Antenna, M12 Connector
WSD2CA2	Wireless Mesh 802.15.4e; 2-Analog Inputs, 1 Digital Output; External Antenna, Conduit Connector
WSD1CA2	Wireless Mesh 802.15.4e; 2-Analog Inputs, 1 Digital Output; Internal Antenna, Conduit Connector
WSD2MA3	Wireless Mesh 802.15.4e; 3-Analog Inputs; External Antenna, M12 Connector
WSD1MA3	Wireless Mesh 802.15.4e; 3-Analog Inputs; Internal Antenna, M12 Connector
WSD2CA3	Wireless Mesh 802.15.4e; 3-Analog Inputs; External Antenna, Conduit Connector
WSD1CA3	Wireless Mesh 802.15.4e; 3-Analog Inputs; Internal Antenna, Conduit Connector
<b>Model Number</b>	<b>Digital Inputs</b>
WSD2MD2	Wireless Mesh 802.15.4e; 2 Digital Inputs, 2 Digital Outputs; External Antenna, M12 Connector
WSD1MD2	Wireless Mesh 802.15.4e; 2 Digital Inputs, 2 Digital Outputs; Internal Antenna, M12 Connector
WSD2CD2	Wireless Mesh 802.15.4e; 2 Digital Inputs, 2 Digital Outputs; External Antenna, Conduit Connector
WSD1CD2	Wireless Mesh 802.15.4e; 2 Digital Inputs, 2 Digital Outputs; Internal Antenna, Conduit Connector

### WZZARDC™ COMMERCIAL MODELS

<b>Wzzard Intelligent Edge Nodes with SmartMesh IP and Bluetooth LE</b>	
<b>Model Number</b>	
WCD1TA3	Wireless Mesh 802.15.4e; 3-Analog Inputs
WCD1TD2	Wireless Mesh 802.15.4e; 2-Digital Inputs, 2 Digital Outputs
WCD1TTJ	Wireless Mesh 802.15.4e; 2-J-type input, 1 Digital Output

# DECLARATION OF COMPLIANCE



## Declaration of Compliance

The undersigned representing the following supplier:

B+B Smartworx  
707 Dayton Road  
Ottawa, Illinois 61350 USA

Herewith declare under our sole responsibility:

Model Numbers        WSDxxxx, WSBxxxx, where xxxx are alphanumeric characters.  
Description            Wzzard Intelligent Edge Node  
                              Wzzard Basic Edge Node

---

**The standards referenced below have been applied:**

EMC:	EN 61000-6-2:2005	Immunity standard for industrial environments
	EN 61000-6-4:2007	Emission standard for industrial environments
	FCC Part 15 CFR Title 47:2014	
	ICES-003: 2012 Digital Apparatus (Industry Canada)	
	EN 61326-1:2012	Electrical equipment for measurement, control and laboratory use – EMC requirements
	EN 55022:2010 +AC:2011	Information technology equipment – Radio disturbance characteristics – Limits and methods of measurement
	CISPR 22 Ed. 6.0b:2008	Information technology equipment - Radio disturbance characteristics - Limits and methods of measurement
	EN 55024:2010	Information Technology Equipment – Immunity Characteristics – Limits and methods of measurement
	CISPR 24:2013	Information Technology Equipment – Immunity Characteristics – Limits and methods of measurement
	IEC/EN 61000-4-2:2009	ESD Immunity
	IEC/EN 61000-4-3:2006+A2:2010	Radiated Immunity
	IEC/EN 61000-4-4:2012	EFT/Burst Immunity
	IEC 61000-4-5:2005	Surge Immunity
	EN 61000-4-5:2006	Surge Immunity
	IEC/EN 61000-4-6:2009	RF Conducted Immunity
Environmental:	EN60068-2-6:2008	Mechanical Vibration, 2G, 0.012in. displacement, 10-500 Hz
	EN60068-2-27:2009	Mechanical Shock, 50G, 11ms.

FCC Class B Notice: this device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: 1. This device may not cause harmful interference. 2. This device must accept any interference received, including interference that may cause undesired operation.

I hereby declare that the products named above meet the essential requirements of and are in conformity with the Standards listed.

A handwritten signature in black ink, appearing to read "Mike Fahrion".

Mike Fahrion  
Director of Product Management  
B+B Smartworx

Date: July 6, 2015  
Place: Ottawa, Illinois, USA



## Declaration of Compliance

The undersigned representing the following supplier:

B+B Smartworx  
707 Dayton Road  
Ottawa, Illinois 61350 USA

Herewith declare under our sole responsibility:

Model Numbers WCDxxxx, , where xxxx are alphanumeric characters.  
Description WzzardC Intelligent Edge Node – Commercial


---

**The standards referenced below have been applied:**

EMC:	EN 61000-6-1:2007	Immunity standard for light industrial environments
	EN 61000-6-3:2006+A1:2011	Emission standard for light industrial environments
	FCC Part 15 CFR Title 47:2014	
	ICES-003:2012 Digital Apparatus (Industry Canada)	
	EN 61326-1:2012	Electrical equipment for measurement, control and laboratory use – EMC requirements
	EN 55022:2010 +AC:2011	Information technology equipment – Radio disturbance characteristics – Limits and methods of measurement
	CISPR 22 Ed. 6.0b:2008	Information technology equipment - Radio disturbance characteristics - Limits and methods of measurement
	EN 55024:2010	Information Technology Equipment – Immunity Characteristics – Limits and methods of measurement
	CISPR 24:2013	Information Technology Equipment – Immunity Characteristics – Limits and methods of measurement
	IEC/EN 61000-4-2:2009	ESD Immunity
	IEC/EN 61000-4-3:2006+A2:2010	Radiated Immunity
	IEC/EN 61000-4-4:2012	EFT/Burst Immunity
	IEC/EN 61000-4-6:2009	RF Conducted Immunity

FCC Class B Notice: this device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: 1. This device may not cause harmful interference. 2. This device must accept any interference received, including interference that may cause undesired operation.

I hereby declare that the products named above meet the essential requirements of and are in conformity with the Standards listed.

  
Mike Fahrion  
Director of Product Management  
B+B Smartworx

Date: July 9, 2015  
Place: Ottawa, Illinois, USA



**Declaration of Conformity**

The undersigned representing the following supplier:

B+B Smartworx  
707 Dayton Road  
Ottawa, Illinois 61350 USA

Herewith declare under our sole responsibility:

Model Numbers WSDxxxx, WSBxxxx, WCDxxxx where xxxx are alphanumeric characters.  
Description Wzzard Intelligent Edge Node  
WzzardC Intelligent Edge Node (Commercial)  
Wzzard Basic Edge Node

---

**These products are in conformity with the provisions of the following directives when used in accordance with the instructions contained in the product documentation.**

1999/5/EC Radio and Telecommunications Terminal Equipment (R&TTE) Directive  
2011/65/EU Reduction of Hazardous Substances Directive

---

**The standards referenced below have been applied:**

EMC: EN55022:2010+AC:2011	Information technology equipment – Radio disturbance characteristics – Limits and methods of measurement
EN55024:2010	Information Technology Equipment – Immunity Characteristics – Limits and methods of measurement
EN61000-4-2:2009	ESD Immunity
EN61000-4-3:2006+A2:2010	Radiated Immunity
EN61000-4-4:2012	EFT/Burst Immunity
EN61000-4-5:2006	Surge Immunity (n/a for WzzardC)
EN61000-4-6:2009	RF Conducted Immunity

---

The authorized representative located within the community maintains a copy of the technical documentation required by the directives: B+B Smartworx, Westlink Commercial Park, Oranmore, Co. Galway, Ireland, Phone: +353 91 792444, Email: [eSales@bb-elec.com](mailto:eSales@bb-elec.com).

I hereby declare that the product named above meets the essential requirements of, is in conformity with, and the CE mark has been applied according to, the relevant European directives listed above using the relevant sections of the European Standards and other normative documents listed above.

Mike Fahrion  
Director of Product Management  
B+B Smartworx

Date: July 9, 2015  
Place: Ottawa, Illinois, USA